| | | Page : 1 of 85 |
|--|--|---|
| KLM Technology | KLM Technology Group | Rev: 02 |
| Group Practical Engineering Guidelines for Processing Plant Solutions | Engineering Solutions www.klmtechgroup.com | Rev 1 May 2010 Rev 2 May 2012 |
| KLM Technology Group P. O. Box 281 Bandar Johor Bahru, 80000 Johor Bahru, Johor, West Malaysia | Kolmetz Handbook Of Process Equipment Design | Co Author Rev 1 Maidafitri Dewi Priati Rev 2 Aprilia Jaya |
| | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | Author Editor |
| | (ENGINEERING DESIGN GUIDELINES) | Karl Kolmetz |

TABLE OF CONTENT

| INTRODUCTION | 4 |
|----------------------------------|----|
| Scope | 4 |
| General Design Consideration | 8 |
| DEFINITION | 17 |
| NOMENCLATURE | 20 |
| THEORY OF THE DESIGN | 22 |
| A. Burner | 22 |
| B. Radiant Section | 27 |
| C. Decoking of fire heater tubes | 39 |
| D. Convection Section | 41 |

| KLM Technology | Kolmetz Handbook | Page 2 of 85 |
|---|--|--------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

| E. Stack | 47 |
|--|----|
| F. Auxiliary Equipment | 52 |
| G. Efficiency of Furnace | 61 |
| APPLICATION | 68 |
| Application 1: Design of furnace with fuel oil | 62 |
| Application 2: Design of furnace with fuel gas | 69 |
| REFEREENCE | 76 |
| LIST OF TABLE | |
| Table 1: The use of fuel at the burner | 25 |
| Table 2: Burner capacity | 25 |
| Table 3: Common Heater Tube Sizes and Properties | 29 |
| Table 4: Design Conditions for Process Heaters | 34 |
| Table 5: Thick fins and studs are typically used in the convection section | 43 |
| Table 6: Minimum pipe spacing for convection section tubes | 44 |
| Table 7: Minimum tube spacing for convection section tubes | 44 |
| Table 8: Rotary Sootblower: for Max. Element Length of 10 in | 56 |
| Table 9: Rotary Sootblower: for Max. Element Length of 20 in | 57 |

LIST OF FIGURE

Figure 1: Vertical cylindrical fired heater: (a) all radiant, and (b) helical coil

6

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.

| KLM Technology | Kolmetz Handbook | Page 3 of 85 |
|---|--|--------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

| Figure 2: | Horizontal tube cabin fired heaters: (a) cabin with convection section and (b) cabin with dividing bridge wall | 7 |
|-----------|--|----|
| Figure 3: | Hoop-tube fired heater | 8 |
| Figure 4: | Vertical tube box fired heaters | 10 |
| Figure 5: | Horizontal tube box fired heaters | 11 |
| Figure 6: | Multiple cell heaters | 12 |
| Figure 7: | Helical coil fired heater | 13 |
| Figure 8: | Typical natural draft burner (combination gas/liquid burner) | 23 |
| Figure 9: | Typical Axial-Flow Burner Forced Draft Combination Gas/Oil Burner | 24 |
| Figure 10 | : Decoking on the fired heater tubes | 40 |
| Figure 11 | : Damper | 50 |
| Figure 12 | 2: Square Pitch Finned Tubes : Longitudinal Arrangement | 54 |
| Figure 13 | :. Triangular Pitch Finned Tubes : Longitudinal Arrangement | 54 |
| Figure 14 | : Square Pitch Finned Tubes : Perpendicular Arrangement | 55 |
| Figure 15 | : Triangular Pitch Finned Tubes : Perpendicular Arrangement | 55 |
| Figure 16 | 5: Fans and Blower: (a) Natural Draft, (b) Forced Draft, (c) Induced Draft and (d) Balance Draft | 59 |
| Figure 17 | ': Air Preheater | 60 |

| KLM Technology Kolmetz Handbook | Page 4 of 85 | |
|---|--|----------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

INTRODUCTION

Scope

This guideline provides knowledge on how to design a furnace. This design guideline can assist to understand the basic design of furnace with suitable size, material and heat of combustion. A furnace is one of the most important pieces of equipment in a process plant. Furnace firing provides a large part of the heat for the process. The heat for the process comes from the combustion of fuels.

The choice of furnace style and design is crucial for the best performance of furnace. Factors affecting the performance of furnace are influenced by the maximum the heat absorbed, the capacity of burners, process requirements, economics and safety.

The theory section explains the selection of the furnace type, calculation of sizing, heat transfer concepts and combustion basics. The application of the furnace theory with the examples assists the user to study the furnace concepts and be prepared to perform the actual design of the furnace.

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.

| KLM Technology | Kolmetz Handbook | Page 5 of 85 |
|---|--|--------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

General Design Consideration

Heat is one of most important things in the process plant industry. Equipment that produces and supplies the heat requirement to process plant is called a furnace. Furnaces have high temperatures, open flames, oxygen and fuel; all the components of combustion.

The term furnace can also refer to a direct fired heater. They expose hydrocarbon stream to heat that drives a distillation tower, a reactor, and in some cases, change the stream's molecular structure through cracking.

Basically furnace has four basic components, consisting of box, burner, coil, and stack. The burner will produce the heat then the heat liberated by the combustion of fuel is transfer to a process fluid flowing through tubular coils. In this below are several types of furnace:

1. Vertical cylindrical fired heater

This furnace is commonly used in hot oil service and other processes where the duties are usually small. These heaters are probably the most common in use today and are used for heat duties up to about 150 MBtu/hr. This type of cylindrical upright, tube in the radiant section mounted vertically in a circle round of the burner. The burner is located on the bottom floor, so that the flame is parallel with the tube. Fire heater of this type can be design without or with convection section. Below is kinds of the cross section of vertical-cylindrical fired heater.

a. Vertical cylindrical all radiant:

The all-radiant heater is inexpensive, but since the temperature of flue gases leaving the heater is high, 1500 – 1800oF. Heater of this type does not have convection section. Usually this type have low efficiency and heat duty ranges from 3-7 million kcal/hour.

b. Vertical cylindrical helical coil:

The coil is arranged helically along the cylindrical wall of the combustion chamber. Its primary use is to heat thermal fluids and natural gas. Capacities range from 1 to 30 million Btu/hour.

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.

| KLM Technology | Kolmetz Handbook | Page 6 of 85 |
|---|--|--------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |


c. Vertical cylindrical with crossflow convection section:

The convection section is installed above the combustion chamber. Mostly, air preheater are added to increase the efficiency. Heat duty of this type from 5-35 million kcal/hour.

d. Vertical cylindrical with integral convection:

The distinguishing feature of this type is the use of added surface area on the upper part of the radiant coil to promote convection heating. This type is added surface area on the upper part of the radiant coil to promote convection heating. Duties are from 2.5 - 25 million kcal /hr.

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.

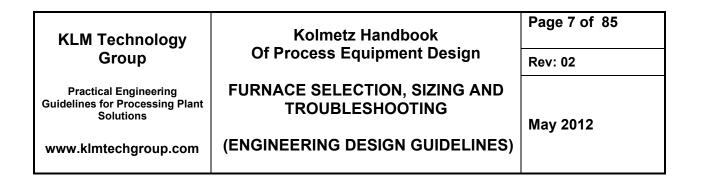

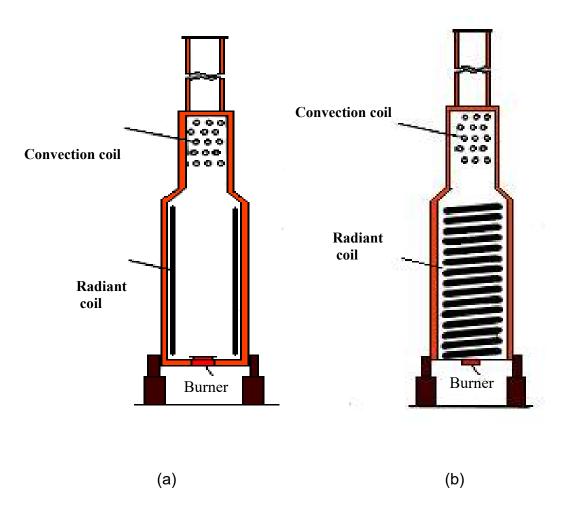


Figure 1: Vertical cylindrical fired heater: (a) all radiant and (b) helical coil


| KLM Technology | KLM Technology Kolmetz Handbook | Page 8 of 85 |
|---|--|--------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |


2. Horizontal tube cabin fired heaters


This cabin has room type consists of the radiation and convection. Tube-tube mounted horizontally while the burner is located on the floor furnace, so that the flame is not straight and parallel to the wall heater. The first layer of tubes in the convection section directly facing into combustion chamber or the radiant fire box called shield tubes. The burner mounted on the floor of the cabin and fire is directed vertically.

Cabin fired heater have some variation in the application. It is like cabin furnace with a centre wall. In the figure below the fire heater usually can be used for the large fired heater and has two separate heating zones are required in the radiant section. This design is economical, high efficiency duties are from 20 - 50 million kcal/hour. In many operations, about 75% of the heat is absorbed in the radiant zone of a fired heater.

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.

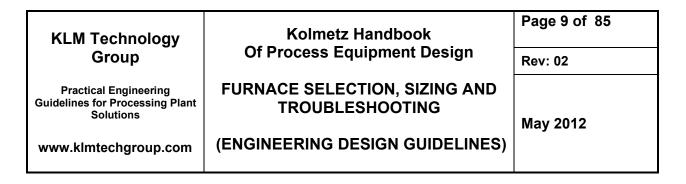

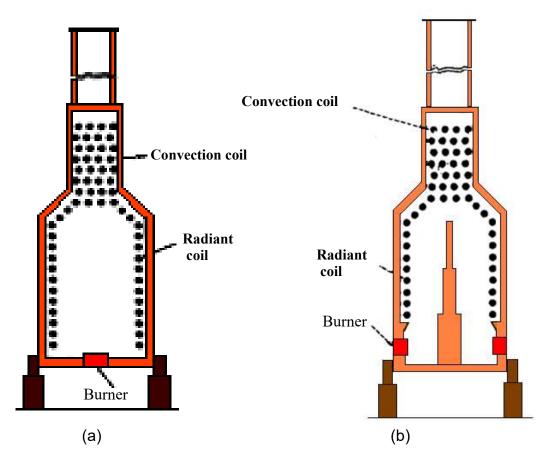



| KLM Technology | Kolmetz Handbook | Page 10 of 85 |
|---|--|---------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

3. Hoop-tube fired heater

This fire heater has tube bent like U-type with vertically oriented. In all-vapor flow, non-coking services where low coil pressure drop is desired. This design is used where the pressure drop must be very low since the path through each tube provides a design with many passes. Application of this type is in the catalytic reformers charge heater. Duties are from 13-25 million kcal/hr.

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.

| KLM Technology | Kolmetz Handbook | Page 11 of 85 |
|---|--|---------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

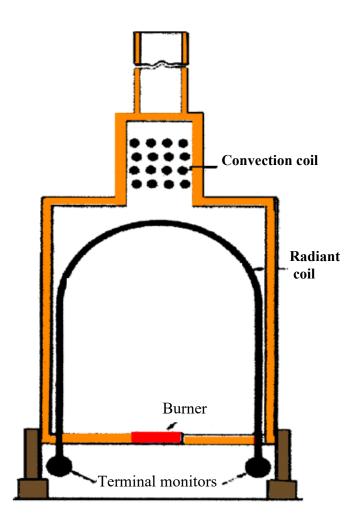


Figure 3:. Hoop-tube fired heater

| KLM Technology | KLM Technology Kolmetz Handbook | Page 12 of 85 |
|---|--|---------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

4. Vertical tube box fired heaters

In this fire heater, tubes stand vertically along wall in the radiant section. Vertical radiant tubes are arranged in a single row in each combustion cell (there are often two cells) and are fired from both sides of the row. Such an arrangement yields a uniform distribution of heat-transfer rates about the tube circumference. This heater is suitable for the large forced-draft burners. Requirement of heat input to each cell provided by burner.

5. Horizontal tube box fired heaters

The radiant and convection section in a typical of horizontal tube box in the **Figure 5** are separate by a wall called bridge wall. Function of bridge wall is to create a good direction of flame and to stream the smoke in to flue stack. Burners are firing from the floor along both sides of the bridge wall. Duties are from 30 to 8 million kcal /hour.


6. Multiple cell heaters


For two-cell horizontal tube box have high efficiency, duties from 25-65 million kcal/hour.


7. Helical coil fired heater


This heater configuration is commonly used where the duties are small. Since each pass consists of a separate winding of the coil, pressure drop options are limited. Many of these only have a radiant section, since efficiency is often not that critical, especially in intermittent services like for a regeneration heater.


These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.

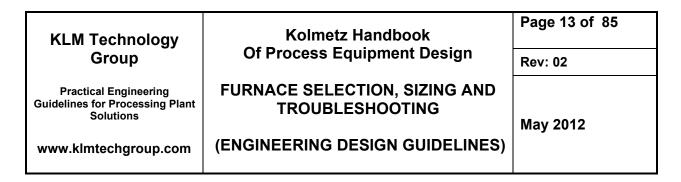

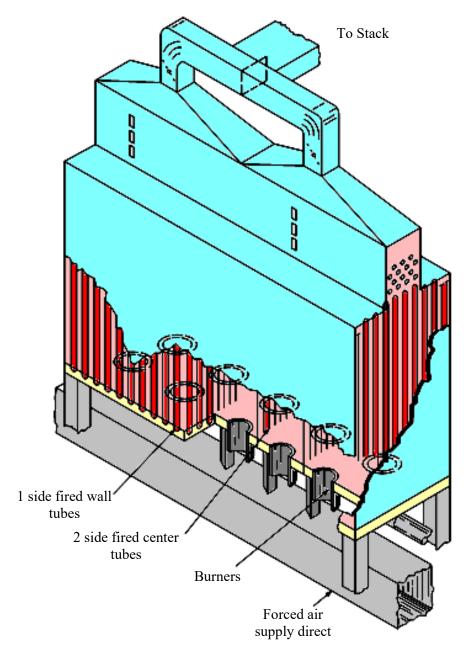



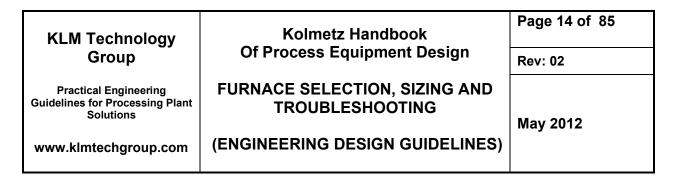

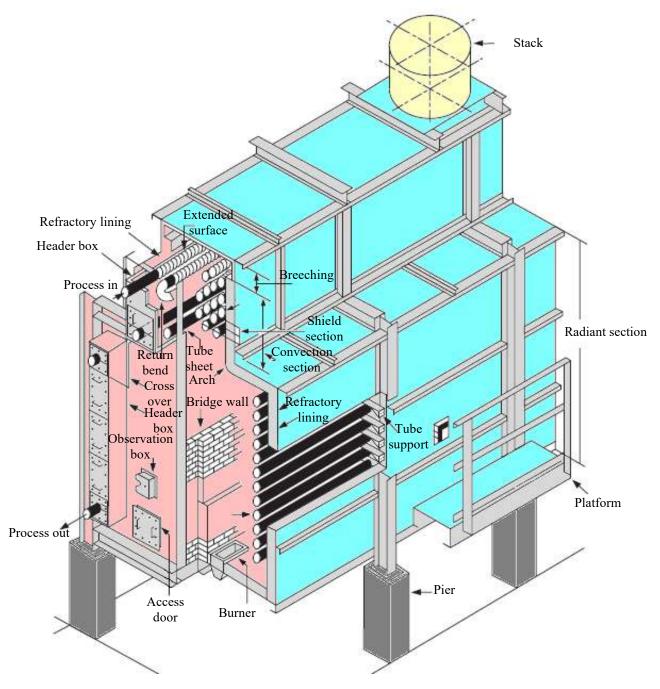

| KLM Technology | Kolmetz Handbook | Page 15 of 85 |
|---|--|---------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

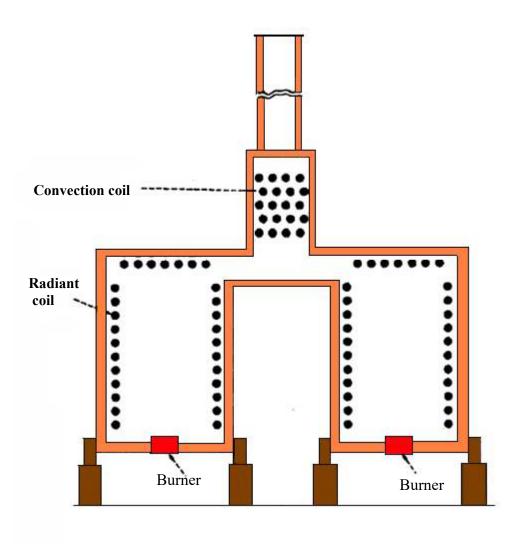
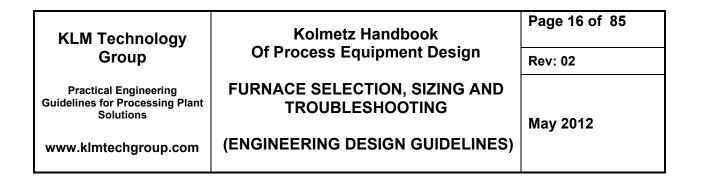


Figure 6: Multiple cell heaters

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.



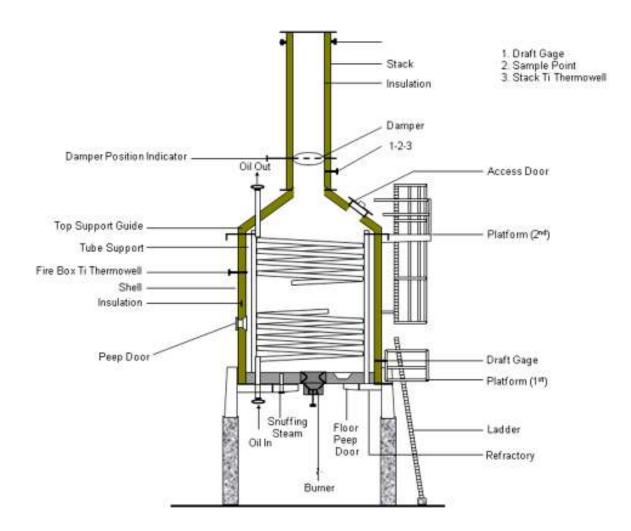


Figure 7: Helical coil fired heater

| KLM Technology | Kolmetz Handbook | Page 17 of 85 |
|---|--|---------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

A Fired heater will work well if designed properly. The design requirements must be properly addressed. Fired heater performance can be measured by a combination of operability and maintenance.

There are several factors effecting fired heater selection and design: all-liquid vaporizing service and all-vapor service.

1. Fire heaters in all-liquid or vaporizing service

Inside the tube wall coke may be formed that can interfere with heat transfer process. Fired heaters should be design to minimize coke. Incipient coke begins to form at a film temperature above about 660oF, usually equivalent to a bulk fluid temperature of about 600oF. In other services such as visbreaking and thermal cracking, where fluid cracking is an inherent characteristic of the process, acceptable coke formation and run length can usually be attained if film temperatures do not exceed 910°F equivalent to a bulk fluid temperature of about 880°F.

For reduce the formation of coke, a high inside film coefficient is necessary to minimize the difference between bulk fluid and film temperature. The higher the speed of the mass of the heat transfer coefficient will be better. Therefore, the mass of turbulent flow must be maintaining in the tube.

2. Fire heater in all-vapor service

For this fired heater service is generally not as susceptible to the severe coking problems as those in vaporizing services because of the lighter nature of the process fluid.

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.

| KLM Technology | Kolmetz Handbook | Page 18 of 85 |
|---|--|---------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

To achieve the lowest possible utility cost, a furnace must operate at maximum efficiency. When a furnace is operated properly, the furnace and its parts have a longer working life with minimum repairs. A properly run furnace is a safe furnace. Skillful handing of a furnace means safety for worker.

Heat is produce by the ignition of fuel at the burner in the firebox. The tubes along the wall of the firebox are the radiant and the shock bank tubes. These tubes receive radiant heat from the burners. The firebox wall and roof is lined with a material then reduce heat losses and radiates heat back to the tubes. The entire furnace structure must be air tight for efficient furnace operation. Air should only enter at designed entries. An air leak reduces the efficiency of the furnace. Below are design considerations for furnace.

- 1. Heaters shall be designed for uniform heat distribution
- 2. Multi-pass heaters shall be designed for hydraulic and thermal symmetry of all passes. The number of passes shall be minimized. Each pass shall be a single circuit
- 3. Average heat flux density in the radiant section is normally based on single row of tubes with two nominal tube diameter spacing.
- 4. The maximum allowable inside film temperature for any process service shall not be exceeded in the radiant, shield, or convection sections.
- 5. minimum radiation loss 2.5 % the total heat input
- 6. Natural draft needs 25% excess air when oil is the primary fuel and 20 % excess air when fuel gas is the primary fuel. In case of forced draft operation, 20% Excess air for fuel oil and 15% Excess air for fuel gas
- 7. Heaters shall be designed such that a negative pressure of at least 0.10 inches of water (0.025 kilopascals) is maintained in the radiant and convection sections at maximum heat release with design excess air.
- 8. The flue gas dew point can be predicted, and the minimum tube-metal temperature can be kept high enough to prevent condensation, if the fuel's sulfur content has been correctly stated. (For estimated flue gas dew points with respect to sulfur content in fuel oil and gas
- 9. In a well-design heater, the radiant-section heat duty should represent more than 60% to 70% of the total heat duty

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.

| KLM Technology | Kolmetz Handbook | Page 19 of 85 |
|---|--|---------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

- 10. The bridge wall temperature should range between 800°C to 1,000°C.
- 11. Higher radiant flux means less heat transfer surface area for a given heat duty; hence, a smaller furnace.
- 12. The higher the film temperature, the greater is the tendency of the fluid (particularly a hydrocarbon) to crack and deposit a layer of coke.
- 13. Heat-transfer fluids tend to degrade quickly at high film temperatures.
- 14. The coke layer acts as an insulator, retarding heat transfer, which could cause tube overheating and lead to tube failure.
- 15. Also, a heavy coke deposit can restrict the flow through the coil, lowering the inside heat transfer coefficient and further increasing the tube wall temperature.
- 16. The smallest firebox for a certain duty will obviously produce the cheapest design.
- 17. The flame impingement and consequent tube failure that could result can be avoided by specifying a minimum safe distance between burners and tubes, based on experience

Followings are the mechanical design for furnace and these will be discussed a much deeper in theory section.

- 1. Provision for thermal expansion shall take into consideration all specified operating conditions, including short term conditions such as steam-air decoking.
- 2. The convection section tube layout shall include space for future installation of sootblowers or steam lancing doors.
- 3. The convection section shall incorporate space for future addition of two rows of tubes.
- 4. When the heater is designed for fuel oil firing, soot-blowers shall be provided for convection section cleaning.
- 5. Vertical cylindrical heaters shall be designed with maximum height to diameter ratio of 2.75, where the height is the radiant section height and the tube circle diameter.
- 6. Shield sections shall have at least three rows of bare tubes.
- 7. Convection sections shall be designed to minimize flue gas bypass. Baffles may be employed.

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.

| KLM Technology | Kolmetz Handbook | Page 20 of 85 |
|---|--|---------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

- 8. The minimum clearance from grade to burner plenum or register shall be 6 feet 6 inches (2.0 meters) for floor fired heaters.
- 9. For vertical cylindrical heaters, the maximum radiant straight tube length shall be 60 feet (18.3 meters).
- 10. For horizontal heaters fired from both ends, the maximum radiation straight tube length shall be 40 feet (12.2 meters).
- 11. Radiant tubes shall be installed with minimum spacing from refractory or insulation to tube centerline of one and one half nominal tube diameters, with a clearance of not less than 4 inches (10 centimeters) from the refractory or insulation.
- 12. For horizontal radiant tubes, the minimum clearance from floor refractory to tube outside diameter shall be not less than 12 inches (30 centimeters).
- 13. The heater arrangement shall allow for replacement of individual tubes without disturbing adjacent tubes.

| KLM Technology | Kolmetz Handbook | Page 21 of 85 |
|---|--|---------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | |

DEFINITIONS

Air Preheater - Heat exchanger device that uses some of the heat in the flue gases to raise the temperature of the air supply to the burners.

Breeching - The hood that collects the flue gas at the convection section exit.

Bridgewall Temperature - The temperature of the flue gas leaving the radiant section

Bulk Temperature - The average temperature of the process fluid at any tube cross section.

Center Wall - A refractory wall in the radiant section, which divides it into two separate cells.

Coil - A series of straight tube lengths connected by 180° return bends, forming a continuous path through which the process fluid passes and is heated.

Convection Section - The portion of a heater, consisting of a bank of tubes, which receives heat from the hot flue gases, mainly by convection.

Corbelling - Narrow ledges extending from the convection section side walls to prevent flue gas from flowing preferentially up the side of the convection section, between the wall and the nearest tubes.

Crossover - Piping which transfers the process fluid either externally or internally from one section of the heater to another.

Damper - A device to regulate flow of gas through a stack or duct and to control draft in a heater.

Draft - The negative pressure (vacuum) at a given point inside the heater, usually expressed in inches of water.

Excess Air - The percentage of air in the heater in excess of the stoichiometric amount required for combustion.

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.

| KLM Technology | Kolmetz Handbook | Page 22 of 85 |
|---|--|---------------|
| Group | Of Process Equipment Design | Rev: 02 |
| Practical Engineering Guidelines for Processing Plant Solutions | FURNACE SELECTION, SIZING AND TROUBLESHOOTING | May 2012 |
| www.klmtechgroup.com | (ENGINEERING DESIGN GUIDELINES) | - |

Extended Surface - Surface added to the outside of bare tubes in the convection section to provide more heat transfer area.

Film - A thin fluid layer adjacent to a pipe wall that remains in laminar flow, even when the bulk flow is turbulent.

Film Temperature - The maximum temperature in the film, at the tube wall.

Fire Box - A term used to describe the structure which surrounds the radiant coils and into which the burners protrude.

Flue Gas - A mixture of gaseous products resulting from combustion of the fuel.

Fouling - The building up of a film of dirt, ash, soot or coke on heat transfer surfaces, resulting in increased resistance to heat flow.

Forced Draft - Use of a fan to supply combustion air to the burners and to overcome the pressure drop through the burners.

Fired Heater Efficiency - The ratio of heat absorbed to heat fired, on a lower heating value basis.

Header Box - The compartment at the end of the convection section where the headers are located.

Heat Available - The heat absorbed from the products of combustion (flue gas) as they are cooled from the flame temperature to a given flue gas temperature.

Heat Density - The rate of heat transfer per unit area to a tube, usually based on total outside surface area.

Heat Duty - The total heat absorbed by the process fluid, usually expressed in MBtu/hr

These design guideline are believed to be as accurate as possible, but are very general and not for specific design cases. They were designed for engineers to do preliminary designs and process specification sheets. The final design must always be guaranteed for the service selected by the manufacturing vendor, but these guidelines will greatly reduce the amount of up front engineering hours that are required to develop the final design. The guidelines are a training tool for young engineers or a resource for engineers with experience.